

- GENERAL NOTES:
1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
 2. APPLICABLE FOR SHINGLE OR METAL ROOF COVERS.
 3. APPLICABLE FOR ROOF PITCH 2:12 OR GREATER.
 4. FOR CONCRETE AND CLAY TILE ROOF COVERS, MINIMUM SHEATHING THICKNESS IS 15/32."
 5. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES, AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS.
- IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.

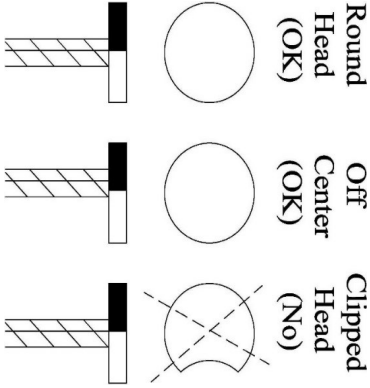
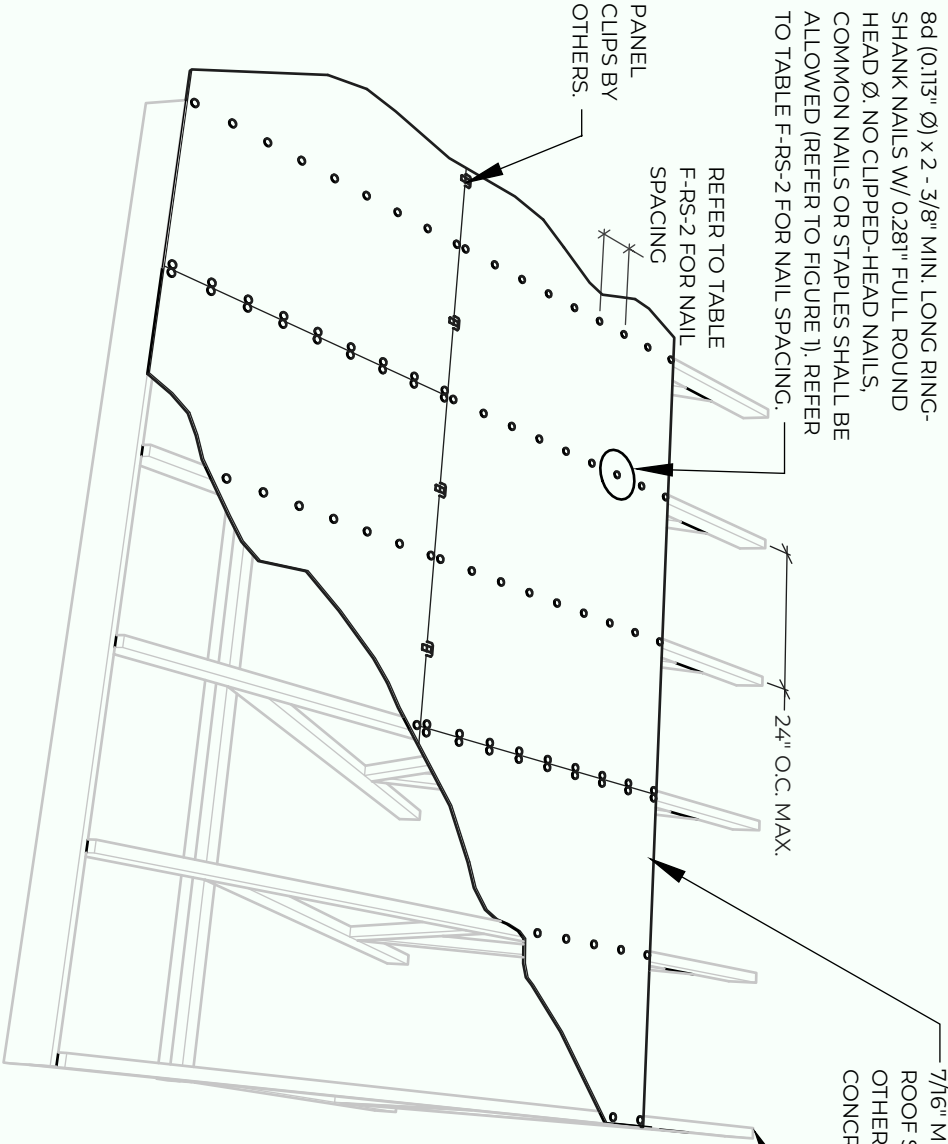


FIGURE 1.

Table F-RS-2: MAXIMUM ALLOWED RING SHANK NAIL SPACING ALONG PANEL EDGES AND INTERMEDIATE FRAMING FOR ATTACHING ROOF DECK WOOD STRUCTURAL PANELS.

DESIGN WIND SPEED		ALL ROOF AREAS
ASCE 7-05 (Vasd)	ASCE 7-10 (Vasd)	
110 MPH OR LESS	130 MPH OR LESS	
GREATER THAN 110 MPH	GREATER THAN 130 MPH	

APPLICABLE STANDARDS:

FORTIFIED HOME™ - HURRICANE (2019)

DESCRIPTION:

HURRICANE - NEW CONSTRUCTION
ROOF DECK ATTACHMENT -
STRUCTURAL WOOD PANELS

DRAWING #:

F-RS-2

DATE:

11/18/2019

