

GENERAL NOTES:


- 1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
- 2. SHINGLES INSTALLED AT ALL INTERSECTIONS AND BOTH SIDES OF OPEN VALLEYS SHALL BE SET IN A MINIMUM 8 IN. WIDE STRIP OF FLASHING CEMENT (MAX. THICKNESS OF FLASHING CEMENT = 1/8"). CUT SIDE OF CLOSED VALLEYS SHALL BE SET IN A MINIMUM 2 IN. WIDE, 1/8" THICK STRIP OF FLASHING CEMENT. WOVEN VALLEYS TO BE ACCORDING TO THE MANUFACTURERS SPECIFICATIONS.
- 3. REFER TO FORTIFIED STANDARD DETAILS F-RC-1 AND F-RC-3 FOR ADDITIONAL ASPHALT SHINGLE INSTALLATION OPTIONS. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.
- 4.

UNDERLAYMENT INSTALLED _____
PER FORTIFIED STANDARD
DETAILS F-SRD-2, F-SRD-3, OR
F-SRD-4.

SHINGLE MANUFACTURER APPROVED
STARTER STRIP SET IN A MINIMUM 8 IN.
WIDE STRIP OF COMPATIBLE FLASHING
CEMENT (MAX. THICKNESS OF FLASHING
CEMENT = 1/8").

VERIFY WITH MANUFACTURER THAT
FLASHING CEMENT/ROOF MASTIC IS
COMPATIBLE WITH UNDERLAYMENT.

DRIP EDGE AND ASTM D41 ASPHALT
PRIMER INSTALLED PER FORTIFIED
STANDARD DETAIL F-DE-1 OR F-DE-2.

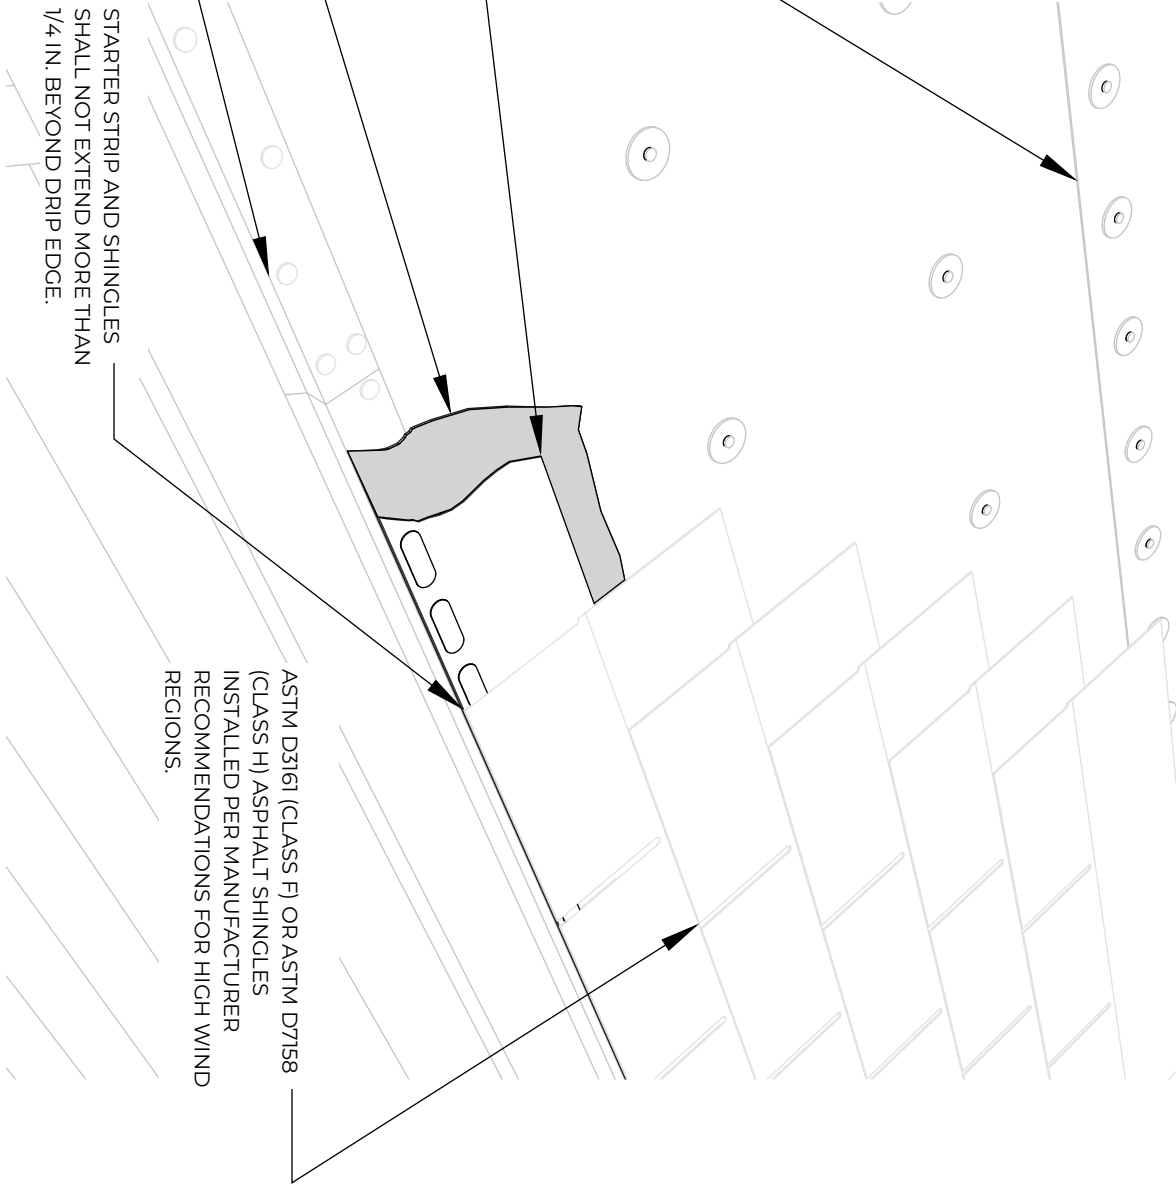

APPLICABLE STANDARDS:

FORTIFIED HOME™ - HURRICANE (2019)
FORTIFIED HOME™ - HIGH WIND (2015)

DESCRIPTION:

ASPHALT SHINGLE INSTALLATION
GUIDANCE FOR STEEP SLOPE -
OPTION 2: SINGLE STRIP STARTER
INSTALLATION AT EAVE OR RAKE

DRAWING #:

F-RC-2

DATE:

11/18/2019

