


- GENERAL NOTES:**
 REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
- REFER TO FORTIFIED STANDARD DETAIL F-G-1 FOR CORROSION PROTECTION REQUIREMENTS.
 - FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES. ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.

WOOD STRUCTURAL PANEL OR OTHER NONPOROUS FLAT SHUTTER CUT TO FIT W/ 7/16" MIN. THICKNESS. PRE-DRILL HOLES AT FASTENER LOCATIONS. SHAPE MAY VARY, BUT NOT TO EXCEED MAX. DIMENSIONS AND FASTENER SPACING SHOWN.

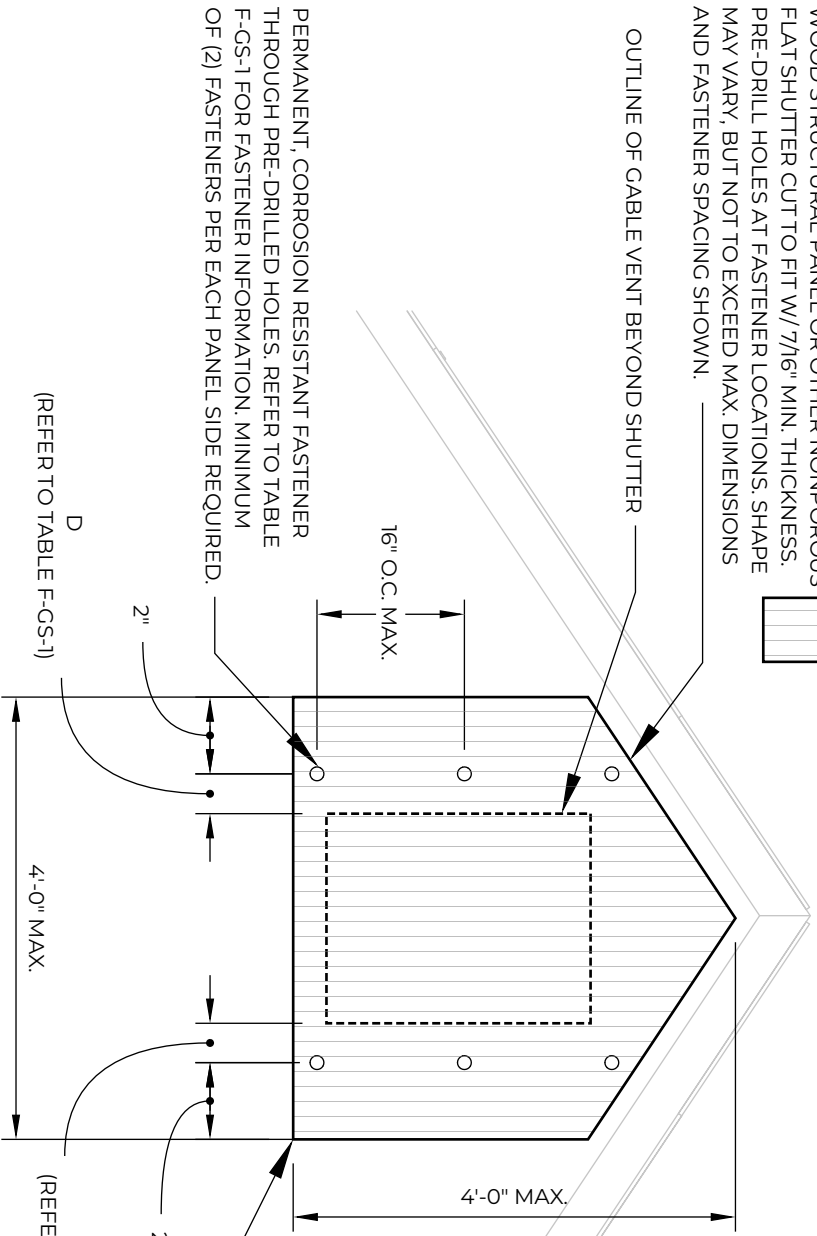

PERMANENT, CORROSION RESISTANT FASTENER THROUGH PRE-DRILLED HOLES. REFER TO TABLE F-GS-1 FOR FASTENER INFORMATION. MINIMUM OF (2) FASTENERS PER EACH PANEL SIDE REQUIRED.

TABLE F-GS-1: FASTENING SCHEDULE FOR CABLE VENT COVER.

SUPPORT STRUCTURE TYPE	FASTENER TYPE & SIZE	END DISTANCE, D
WOOD	1/4" Ø LAG SCREWS W/ 2" EMBEDMENT & 1" Ø WASHER	1"
CONCRETE OR GROUTED MASONRY	1/4" Ø FASTENER W/ 2" EMBEDMENT & 1" Ø WASHER	1.5"

NOTES: WHERE SCREWS ARE ATTACHED TO MASONRY OR MASONRY/STUCCO, USE VIBRATION-RESISTANT ANCHORS W/ 1500 LBS MIN. WITHDRAWAL CAPACITY.

SEAL SHUTTER AROUND THE EDGES OF THE CABLE VENT SO THAT WATER DRAINS TO OUTSIDE.

SHUTTER CAN BE INSTALLED FROM OUTSIDE OF HOUSE OR FROM INSIDE OF ATTIC.

APPLICABLE STANDARDS:

FORTIFIED HOME™ - HURRICANE (2019)

DESCRIPTION:

CABLE VENT SHUTTERING

DRAWING #:

F-GS-1

DATE:

11/18/2019

