

GENERAL NOTES:

1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
2. REFER TO FORTIFIED STANDARD DETAIL F-C-1 FOR CORROSION PROTECTION REQUIREMENTS.
3. APPLICABLE FOR ROOF PITCH 2:12 OR GREATER. REFER TO AND INSTALL IN ACCORDANCE WITH MANUFACTURER SPECIFICATIONS AND INSTALLATION INSTRUCTIONS. REFER TO PRODUCT APPROVAL TO VERIFY REQUIRED WIND PRESSURES ARE MET IF APPLICABLE.
4. ADEQUATE ATTIC VENTILATION IS REQUIRED. REFER TO UNDERLAYMENT AND PRIMARY ROOF SYSTEM MANUFACTURERS INSTALLATION INSTRUCTIONS FOR VENTILATION LIMITATIONS. ALSO CHECK WITH LOCAL BUILDING CODES FOR RESTRICTIONS.
5. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.
- 6.

FLASHING TAPE AT ALL PANEL SEAMS _____ FULLY ADHERED W/ NO WRINKLES OR VOIDS USING ROLLER.

MATERIAL OPTION 1: 4" WIDE ASTM D1970 COMPLIANT SELF-ADHERING POLYMER - MODIFIED BITUMEN FLASHING TAPE.


MATERIAL OPTION 2: 3 - 1/4" WIDE AAMA 711-13 LEVEL 3 (FOR EXPOSURE UP TO 80°C/176°F) COMPLIANT SELF-ADHERING FLASHING TAPE.

ANCHOR SHEET: ASTM D226 TYPE II #30 UNDERLAYMENT.

TACK UNDERLAYMENT IN PLACE WITH ROOFING NAILS ONLY AT EDGES. DO NOT INSTALL CAPS AT EDGES UNTIL DRIP EDGE IS IN PLACE. DRIP EDGE SHALL BE INSTALLED ON TOP OF ANCHOR SHEET PER F-DE-1 AND F-DE-3, BUT UNDER TILE CAP SHEET PER F-DE-2.

ROOF SHEATHING 15/32" MIN.; REFER TO FORTIFIED STANDARD DETAILS F-RS-1, F-RS-2, AND F-RS-3.

6" MIN. OVERLAP FOLDED OVER RIDGE ON BOTH SIDES.

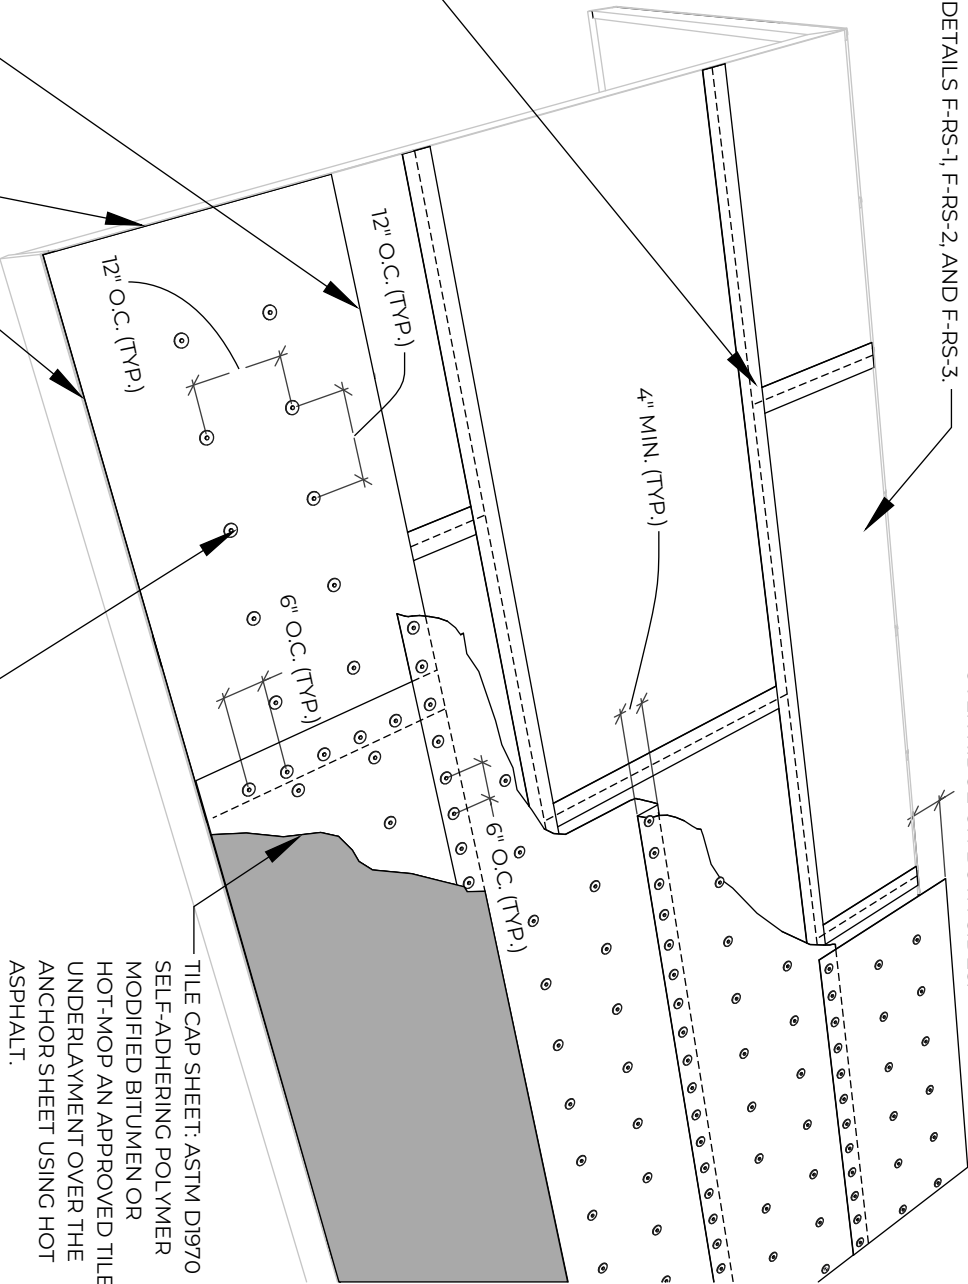

NOTE: 36" WIDE SHEET SHOWN FOR WIDER SHEETS, ADDITIONAL ROW(S) OF NAILS WILL BE NEEDED.

TILE CAP SHEET: ASTM D1970 SELF-ADHERING POLYMER MODIFIED BITUMEN OR HOT-MOP AN APPROVED TILE UNDERLAYMENT OVER THE ANCHOR SHEET USING HOT ASPHALT.

ANNULAR RING OR DEFORMED - SHANK ROOFING NAILS W/ 1" Ø BUTTON CAPS SPACED AS SHOWN OR A MORE STRINGENT FASTENER SCHEDULE IF REQUIRED BY MANUFACTURER.

6" O.C. ON ALL SIDES AND END LAPS.

12" O.C. MAX. BOTH HORIZONTALLY AND VERTICALLY BETWEEN LAPS.

APPLICABLE STANDARDS:

FORTIFIED HOME™ - HURRICANE (2019)
FORTIFIED HOME™ - HIGH WIND (2015)

DESCRIPTION:

SEALED ROOF DECK - FLASHING TAPE, UNDERLAYMENT AND ROOF TILE CAP SHEET - CONCRETE AND CLAY TILE ROOF COVERS, STEEP SLOPE

DRAWING #:

F-SRD-5

DATE:

11/18/2019

