

NEW SITE BUILT DOUBLE GLAZED PERMANENT
FIXED INTERIOR INSULATING GLASS UNIT (IGU),
WINDOW TO BE SEALED AT PERIMETER TO
PREVENT AIR LEAKAGE INTO INTERSTITIAL SPACE

EXISTING WINDOW GLAZING TO BE
REFURBISHED, REPLACE BROKEN PANES OF
GLASS AND GLAZING PUTTY AS NEEDED

EXISTING WINDOW FRAME TO BE REFURBISHED,
CLEAN, SCRAPE LOOSE PAINT, REPAIR WOOD
DAMAGE, AND REFINISH AS NEEDED

NEW GLAZING TAPE (BUTYL)

NEW WEATHERSTRIPPING AT WINDOW
SILL, ATTACH TO FACE OF TRIM

NEW SEALANT

NEW BOTTOM RAIL WEATHERSTRIPPING
INSERTED INTO NEW ROUTED GROOVE



EXISTING WINDOW SILL TO BE REFURBISHED,
CLEAN, SCRAPE LOOSE PAINT, REPAIR WOOD DAMAGE,
AND REFINISH AS NEEDED TO PROVIDE SMOOTH
SURFACE FOR NEW BOTTOM RAIL WEATHERSTRIPPING

NEW SEALANT

EXISTING WINDOW TRIM

EXISTING SHEATHING AND STUD WALL

EXISTING SIDING

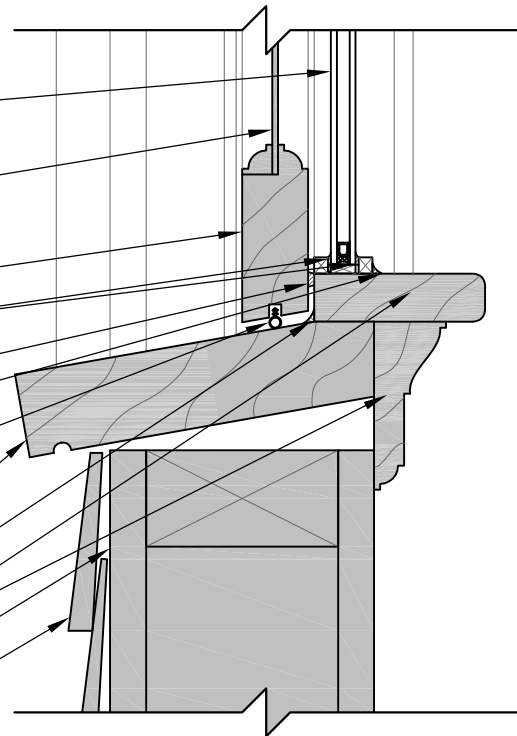

GRAY TONE INDICATES
EXISTING STRUCTURE

WINDOW SILL AT WOOD FRAME WALL - D

SCALE: 3" = 1'-0"



Wood Frame Wall
Window Retrofit Options

Date: 2011-11-03

Sheet Title:

W-WSd